




P.O. Box 2956 · Syracuse · New York · 13220
 Phone: (315) 433-1150 Fax: (315) 433-1521
 Toll Free US & Canada (800) 334-0837
 Email: sales@infitec.com

SDIR SERIES DELAYED INTERVAL OPEN BOARD TIME DELAY RELAY

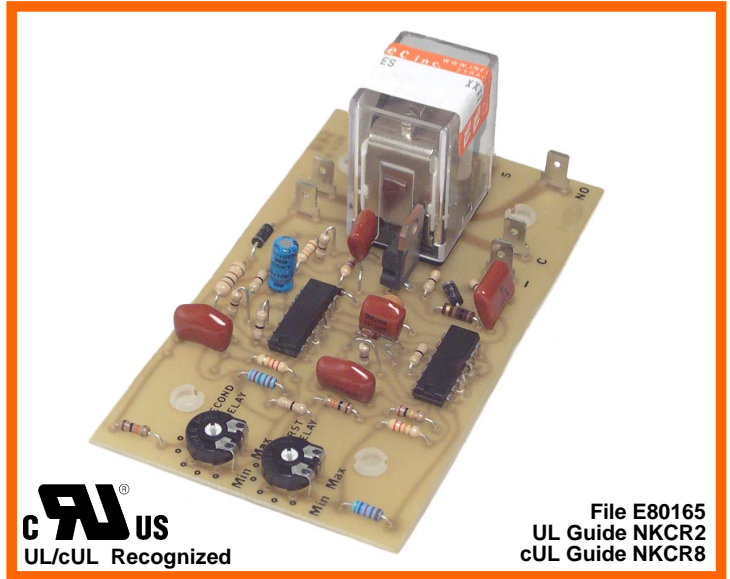

File E80165
 UL Guide NKCR2
 cUL Guide NKCR8

FEATURES

- C/MOS Digital Circuitry
- Time Delays From 0.05 Seconds To 1000 Minutes
- No First Cycle Effect
- 0.5% Repeat Accuracy
- 2% Stability Over Voltage And Temperature
- Low Cost Open Board Construction
- DPDT 10 Ampere Output Rating

SPECIFICATIONS

1. Time Delay.

- 1.1 Type: C/MOS Digital Circuitry
- 1.2 Range: From 0.05 seconds to 1000 minutes. Fixed delays available (see time delay range chart)
- 1.3 Repeat accuracy: $\pm 0.5\%$ under fixed conditions
- 1.4 Setting accuracy: $\pm 10\%$
- 1.5 Reset time: 100 milliseconds maximum
- 1.6 Recycle time: 150 milliseconds
- 1.7 Time delay vs. voltage and temperature: $\pm 2\%$

2. Input.

- 2.1 Operating voltage: 24, 120 & 230 VAC, 12, 24 & 110 VDC
- 2.2 Tolerance: $\pm 20\%$ of nominal
- 2.3 Frequency: 50 - 60 Hertz

3. Output.

- 3.1 Type: Electromechanical relay
- 3.2 Form: DPDT
- 3.3 Rating: 10 amperes resistive @ 30 VDC, 120/240 VAC
- 3.4 Life: Electrical - full load - 1,000,000 operations
 Mechanical - 10,000,000 operations

4. Protection.

- 4.1 Transient: ± 1500 volts for 150 microseconds
- 4.2 Polarity: DC units are reverse polarity protected
- 4.3 Dielectric breakdown: 1500 volts RMS minimum

5. Mechanical.


- 5.1 Mounting: #6 screw clearance (4 places)
- 5.2 Termination: 3/16" or 1/4" quick connect terminals
- 5.3 Style: Open board / surface mount

6. Environmental.


- 6.1 Operating temperature: -20°C to $+80^{\circ}\text{C}$
- 6.2 Storage temperature: -30°C to $+85^{\circ}\text{C}$
- 6.3 Humidity: 95% relative, non-condensing

MODE OF OPERATION DELAYED INTERVAL


Upon application of power to the input terminals, the **OFF** delay begins. Upon completion of the **OFF** delay, the output contacts transfer and the **ON** delay begins. Upon completion of the **ON** delay, the output contacts revert to their original position. Reset is accomplished by removal of input power.

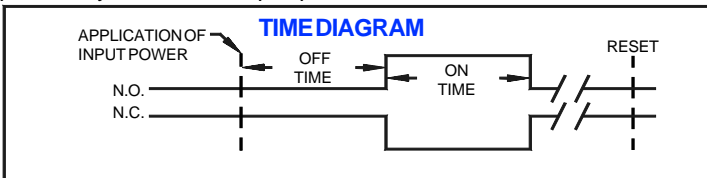

DIMENSIONS

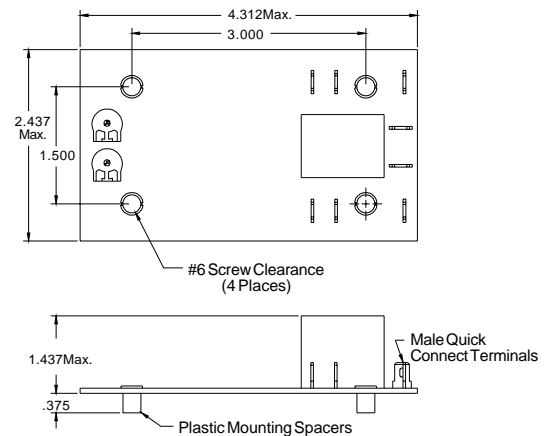

CONNECTION DIAGRAMS

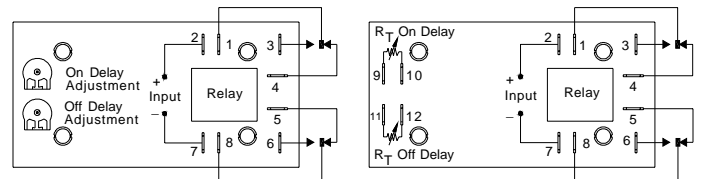

ORDERING INFORMATION

SERIES	TERMINATION	INPUT VOLTAGE	ADJUSTMENT	1ST TIME RANGE	2ND TIME RANGE
SDIR	2 - 3/16" Quick Connect 3 - 1/4" Quick Connect	1 - 12 VDC 2 - 24/28 VDC 3 - 110 VDC 4 - 24 VAC 5 - 120 VAC 6 - 230 VAC	0 - Local 1 - Fixed		See Time Delay Range Chart